

**IMPORTANT:** IN THE INTEREST OF PRODUCT PERFORMANCE AND SAFETY PLEASE READ THESE INSTALLATION AND WARRANTY INSTRUCTIONS BEFORE INSTALLING THE PRODUCT.



SAL products are designed in accordance with all mandatory International and AS/NZS Standards, which require installation in accordance with AS/NZS3000 by a qualified installer and regular cleaning and maintenance of the equipment. Products are sold in accordance with the following instructions and SAL standard terms and conditions of sale, available via [www.sal.net.au](http://www.sal.net.au).

Due to continued product and information updates, product data sourced from [sal.net.au](http://sal.net.au) shall not form part of any contract and or technical performance guarantee unless expressly confirmed in writing by SAL at the time of order.

**PIXIE Blind & Signal Control - PC206BS/R/BTAM** electrical and installation specification effective 28/9/2020.

Model No.	Input (V)/(Hz)	Output Relay Rating	Mass (g)	Dimensions L x W x H (mm)
PC206BS/R/BTAM	240/50	6A per channel (2 channels)	75	110 x 40 x 26

Operating ambient min/max (°C)	0 to 40	Storage ambient limit (°C)	0 to 60
Operating humidity	10% to 85% RH, NC	Storage humidity	+10% to 85% RH
Product application	Interior residential		
Product installation orientation	As per wiring diagram		
PIXIE connectivity	Yes		
Termination of the product must be made in accordance with the IP rating. Product IP rating – IP20			

**Introduction:** This product is designed with two relays to generate two channel **dry contact signal outputs**, which as an example is ideal for controlling blinds and garage door functions.

**General product application requirements (if applicable):**

1. **CCT and POWER selections (where supplied)** – IMPORTANT, where CCT colour temperature or POWER selection switching is provided, it is important to switch OFF the power before the selection is made, otherwise equipment damage may occur.

2. **Recycling** – SAL encourages recycling, please consider the environment when disposing of packaging, batteries & components.

3. **Switching or test intervals** – For optimum product performance, good design practice does not encourage 24/7 operation of lighting products without the provision of a routine switching or regulatory test cycle. As a guide for continual operation installations, a twelve (12) hour duration for Industrial and Commercial applications and a six (6) hour duration for Residential applications should be considered.

4. **Product maintenance** – In line with the relevant design standards and to protect your investment, it is important to have in place a routine cleaning program that reflects the installation environment and maintains the product in a clean and functional condition.

**IMPORTANT** - The supply must be isolated before any product maintenance or cleaning is conducted. In addition, damage to ANY cable or cord supplied with the product must be addressed as follows; For attachment type X having a specially prepared cable, if the external flexible cable is damaged, it must be replaced by an equivalent cable exclusively available from the manufacturer or authorised installer. For attachment type Y, if the external flexible cable is damaged, it must be exclusively replaced by an equivalent cable by the manufacturer or authorised installer. For attachment type Z, if the external flexible cable is damaged, the cable cannot be replaced and the luminaire must be destroyed.

5. **Adverse, corrosive and coastal installation environments** – Unless the product is specifically designated for such applications in these installation instructions, which is supported by a professional maintenance program; installation of equipment in such environments is not recommended.

6. **Dimming products** – Dimming circuits and product compatibility must be validated by the installer before installation; SAL cannot be responsible for third party changes in dimmer compatibility.

7. **Suspended products** – For installation safety, any suspended products must NOT be installed in high air movement spaces or locations subject to impact.

8. **Light source replacements** – (Non-replaceable light sources) - The light source of the product is deemed not replaceable, when the product reaches its end of life the complete product, it must be replaced by a qualified installer. (Non-user replaceable light sources) - The light source of the product must only be replaced by the manufacturer or qualified installer. **Caution, risk of electric shock.**

9. **Interior downlights and sensors with remote drivers and electrical accessories** – The mounting facilities provided for the transformer/driver (if any), need only be utilized if in the application of the product is required by AS3000. Drivers are not designed for installation environments that restrict conventional airflow.

10. **Floodlight products** – Unless nominated aiming restrictions or installation parameters apply, products are designed for installation environments between ground and 15 metres in height, subject to the desired optical performance being achieved.?

11. **Emergency enabled products** – In the interest of transport and safety, emergency products are supplied with the battery disconnected. In addition to specific emergency commissioning instructions, this battery MUST be connected at the time of installation.

12. **Specific installation procedures** (if any) - this device must be installed by a licensed electrician:

**LED indicator:** LED indicator **colour is white** when the product is new or has been reset; LED indicator **colour is blue** when product is added to a network; LED indicator is **low brightness** when in standby, and **maximum brightness** when the relay is closed.





**Buttons and terminals:**

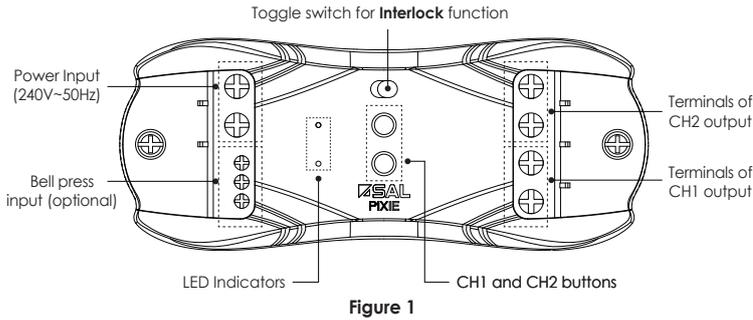


Figure 1

**Wiring diagram (Typical dry contact signal output)**

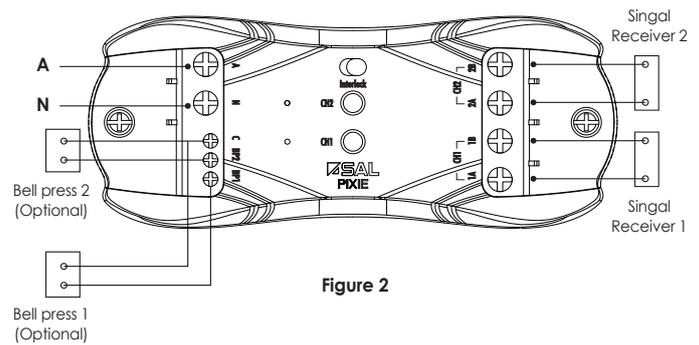


Figure 2

**Button Operation (optional):** It's optional that user can wire bell press (momentary switches) as per **Figure 2**, the operations of bell press are

Operation	Function Description	LED Indicator	Remark
<b>1 click</b>	Relay closes quickly then opens	High brightness signal indicates, then returns to low brightness	The relay action simulates a short pulse signal, equal to a quick press action on the bell press (momentary switch)
<b>Long press</b>	Relay closes until pressure is released from the button	High brightness signal is maintained whilst pressing the button, then once released it returns to low brightness	The relay action simulates a long pulse signal, equal to a long press on the bell press (momentary switch)

**Button Operation**

Operation	Function Description	LED Indicator	Remark
<b>1 click</b>	Relay closes quickly then opens	High brightness signal indicates, then returns to low brightness	The relay action simulates a short pulse signal, equal to a quick press action on the bell press (momentary switch)
<b>Long press</b>	Relay closes until pressure is released from the button	High brightness signal is maintained whilst pressing the button, then once released it returns to low brightness	The relay action simulates a long pulse signal, equal to a long press on the bell press (momentary switch)
<b>4 clicks</b>	Correspondent channel enters pairing mode	Quickly flash blue and white for 30 seconds	This is used to pair a slave device like PIXIE multifunction control (model No. SMF/BT), or PIXIE multifunction remote control (model No. SMC/BT) with the correspondent channel, to achieve remote control. After a successful pairing, pairing mode will end. Pressing any button on this product during pairing mode will cancel pairing mode.
<b>9 clicks</b>	Reset whole product to factory default	Flash white and blue for 3 seconds, then stay white	This operation will reset the product to factory default. LED indicators stay white when successfully reset.

**Interlock Function (Toggle switch)**

Left (Interlock Off)	Right (Interlock On)
Default status. When the Interlock is Off, the CH1 relay and CH2 relay are free to close or open as per the control operations.	For some applications, CH1 relay and CH2 relay closing simultaneously is not permitted, whereby the Interlock must be activated. When the Interlock is activated, only one relay signal is acknowledged.

Scan QR code or go to App store (IOS) or Google Play (Android) to download the free PIXIE app to your smart phone. IOS: Requires IOS 6.0 or later. Compatible with iPhone, iPad and iPad touch Android: Requires Android 4.4 or above, devices must support Bluetooth 4.0  
Specifications above are for reference only and may vary without prior notice



**13. Warranty** – In accordance with SAL's standard terms and conditions of sale, SAL warrant this product to be free from defects in materials and or workmanship for a period as stated below for goods not subject to incorrect installation, maintenance, operation, mishandling, environmental, unauthorised modifications or electrical operating conditions outside the nominated product specification as detailed in these installation instructions. The benefits to you given by this warranty are in addition to other rights and remedies you have under law. Our goods come with guarantees that cannot be excluded under the Australian Consumer Law. You are entitled to a replacement or refund for a major failure and compensation for any other reasonably foreseeable loss or damage. You are also entitled to have the goods repaired or replaced if the goods fail to be of acceptable quality and the failure does not amount to a major failure.

**Warranty term** – Residential usage (12) months, Commercial usage (12) months and Lithium batteries where supplied (24) months from date of purchase. For New Zealand, please refer to [www.sal.co.nz](http://www.sal.co.nz) for warranty conditions and service.

**How to make a claim?**

**Step # 1** – Within 30 days of the fault discovery, please contact the original place of the SAL product purchase during standard (local) business hours, with the following information **(a)** proof of purchase **(b)** description and quantity of the claimed fault **(c)** address of installation. **(d)** operating hours of the product.

**Step # 2** – It is then the responsibility of the original place of product purchase to report the matter to SAL after sales;

NSW   ACT	- SAL National Pty Ltd, 40 Biloela Street Villawood NSW 2163	P # 02 9723 3099
QLD	- SAL National Pty Ltd, 36 Whitelaw Place Richlands QLD 4077	P # 07 3879 5999
VICT   TAS   SA   NT	- SAL National Pty Ltd, 46-48 Keys Road Moorabbin Victoria 3189	P # 03 9532 3168
WA	- SAL National Pty Ltd, 29 Beringarra Av Malaga WA 6090	P # 08 9248 7458
NZ	- Hamer, 130 Bush Road, Albany, Auckland, 0632	P # 0800 239 239

**Step # 3** – Upon review of your claim and if the product is required to be returned to SAL for technical evaluation, then at the owners expense the product must be returned to SAL as per the above nominated locations.

**Step # 4** – Pending the evaluation, the claim will be validated resulting in the product being repaired or replaced with the same or best equivalent product at the discretion of SAL, or rejected if the product fault was found to be caused by conditions beyond the responsibility of SAL warranty obligations. Consideration of installation, product removal, return freight and or testing fees are not the responsibility of SAL.

